

**FLOWTITE PRODUCTS**



SEPTIC/WASTE WATER

NOTE: CUSTOMER SUPPLIED "ASTM C-1644" APPROVED FLEXIBLE PIPING COUPLING REQUIRED ON TANGENTIALLY MTD. NOZZLES, & PIPES

SHELL CODES: 1-E6S09SD, 1-E6SECSO

THIS IS AN IAPMO APPROVED TANK THE ONLY CHANGE ALLOWED TO THIS TANK IS TO INCREASE THE INLET AND OUTLET PIPE DIAMETER. MFG. PER. PE-C22.85

CAPACITIES:  
 LIQUID VOLUME BELOW OUTLET = 2,764 GALS  
 AIR VOLUME ABOVE OUTLET = 423 GALS

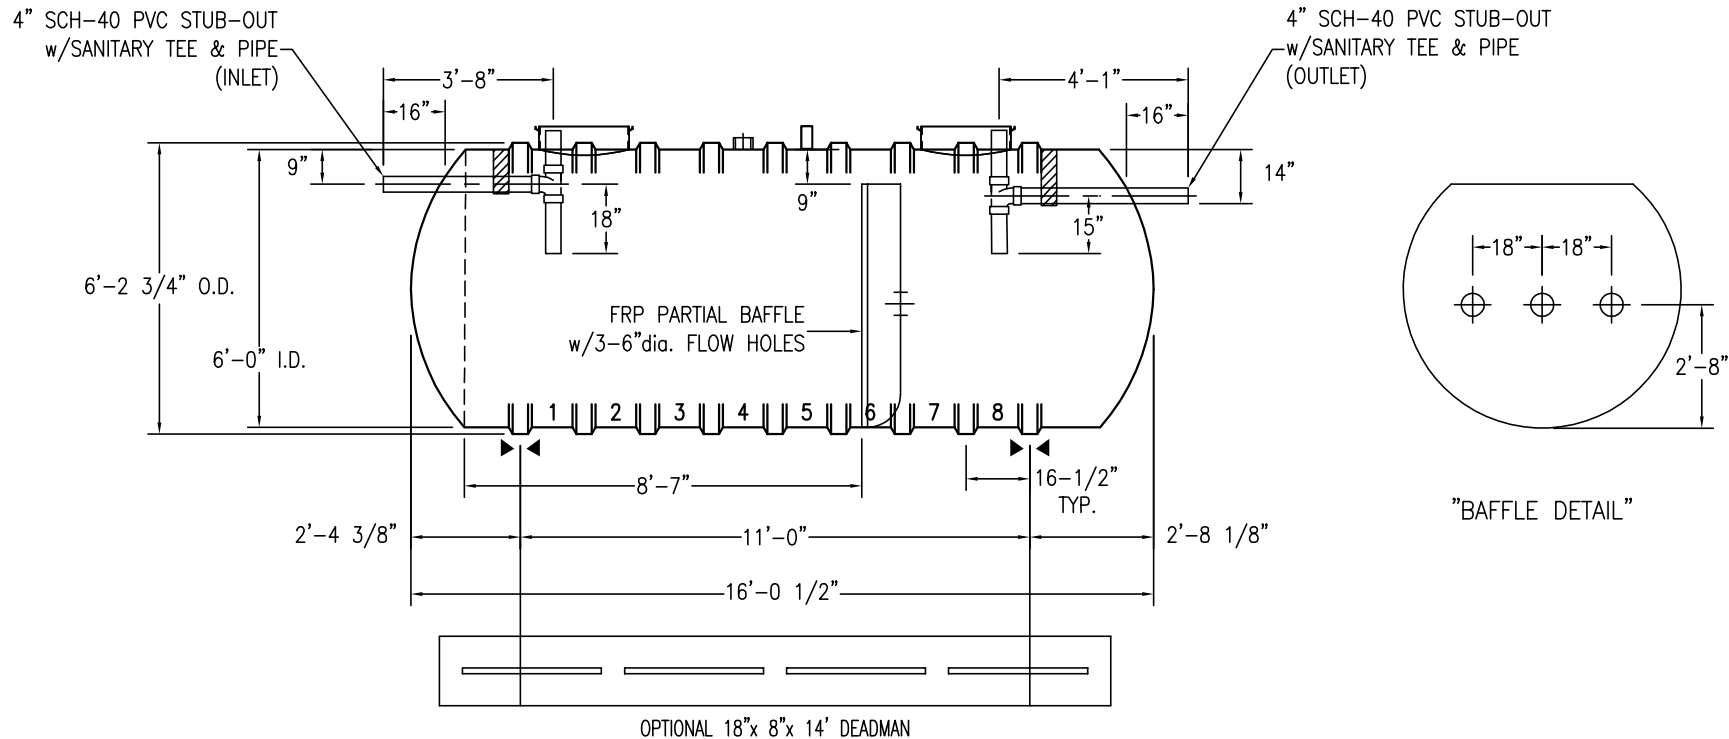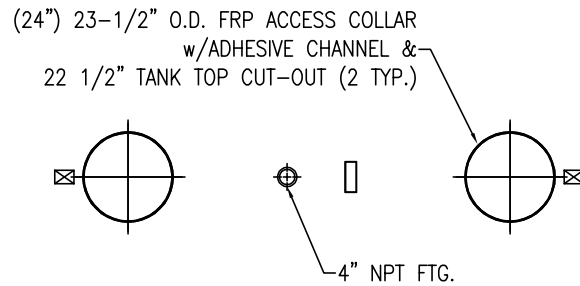

- NOTES:
- ☒ HOLD DOWN STRAP CLIP
  - ▶◀ HOLD DOWN STRAP LOCATION
  - TYPE "13" LIFT LUG - SD
  - TYPE "13" LIFT LUG - HD

SWT D-6 (6')-3000		DATE:	1/1/2014
IAPMO SEPTIC TANK		DRAWN BY:	K.A.SOEDER
<b>CONTAINMENT SOLUTIONS</b>	CAPACITY:	3,187	
	WEIGHT: DRY/WET	1500	
		DWG NUMBER:	63MSW-IS