

FLOWTITE PRODUCTS

RAINWATER HARVESTING

NOTE: CUSTOMER SUPPLIED
"ASTM C-1644" APPROVED
FLEXIBLE PIPING COUPLING
REQUIRED ON TANGENTIALLY
MTD. NOZZLES, & PIPES

INLET/FILL FTG.

FRP ACCESS COLLAR
w/ADHESIVE CHANNEL

SHELL CODES: 2-EXS07SD


THIS IS AN IAPMO APPROVED TANK
COMPLIANCE STANDARDS AND CODES:
IAPMO/ANSI Z1002
UNIFORM PLUMBING CODE (UPC)
MFG. PER PE-C22.85



TANK VENT FTG.

PVC ACCESS RISER
w/WATERTIGHT LOCKING COVER

STUB-OUT (OVERFLOW)

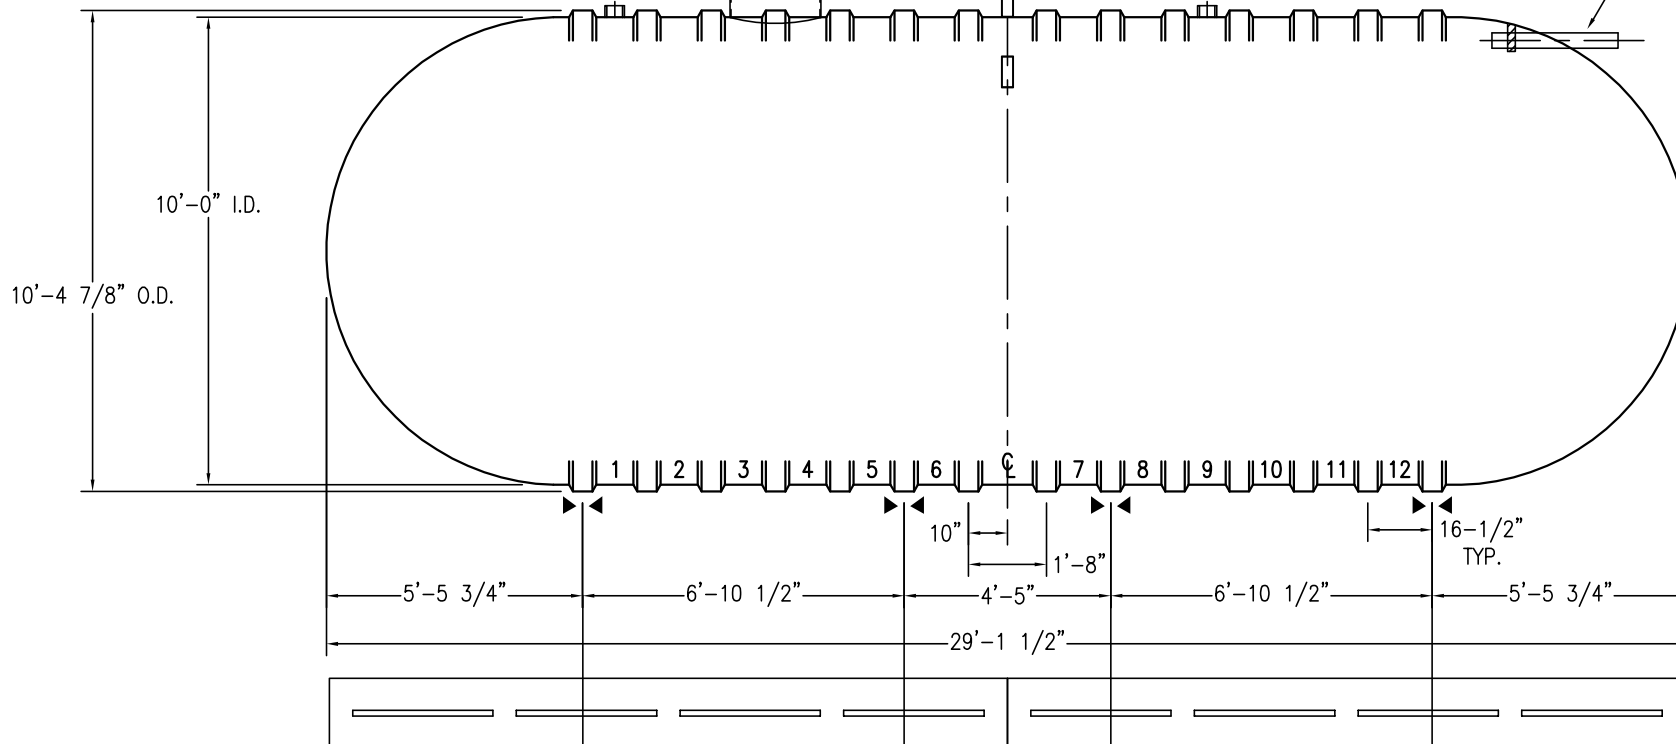

OPTIONAL 18"x 8"x 14' DEADMAN

OPTIONAL 18"x 8"x 14' DEADMAN

IAPMO Z1002 MINIMUM REQUIRED TANK OPENINGS

- 1-ACCESS COLLAR OPENING (24", 30" or 36")
- 1-ACCESS RISER w/WATERTIGHT LOCKING COVER
- 1-INLET/FILL FITTING (4" MIN)
- 1-TANK OVERFLOW (EQUAL TO THE INLET)
- 1-TANK VENT (EQUAL TO LARGER-INLET OR OVERFLOW)

SWT D-6 (10')-15000

DATE:
7/28/2016

IAPMO RAINWATER HARVESTING

DRAWN BY:
R.OXNER

CONTAINMENT
SOLUTIONS S.

CAPACITY:
15,104

REVISED:
4/16/17-A

WEIGHT: DRY/WET
4750

DWG NUMBER:
10-15 IRWH

THIS DIAGRAM IS THE PROPERTY OF CONTAINMENT SOLUTIONS, INC., AND IS FOR ILLUSTRATION PURPOSES ONLY. IT IS NOT TO BE RELIED UPON FOR ANY OTHER PURPOSE. NO WARRANTY OF MERCHANTABILITY OF FITNESS FOR A PARTICULAR PURPOSE OR OF ANY OTHER KIND, EXPRESSED OR IMPLIED IS HEREBY MADE. COPYRIGHT © 2016 CONTAINMENT SOLUTIONS, INC. ALL RIGHTS RESERVED.