

FLOWTITE PRODUCTS

SEPTIC / WASTE WATER

NOTE: CUSTOMER SUPPLIED
"ASTM C-1644" APPROVED
FLEXIBLE PIPING COUPLING
REQUIRED ON TANGENTIALLY
MTD. NOZZLES, & PIPES



SHELL CODES: 2-EXS10SD



THIS IS AN IAPMO APPROVED TANK
THE ONLY CHANGE ALLOWED TO
THIS TANK IS TO INCREASE THE
INLET AND OUTLET PIPE DIAMETER.
MFG. PER. PE-C22.85

CAPACITIES:

LIQUID VOLUME BELOW OUTLET = 17,699 GALS
AIR VOLUME ABOVE OUTLET = 2,252 GALS

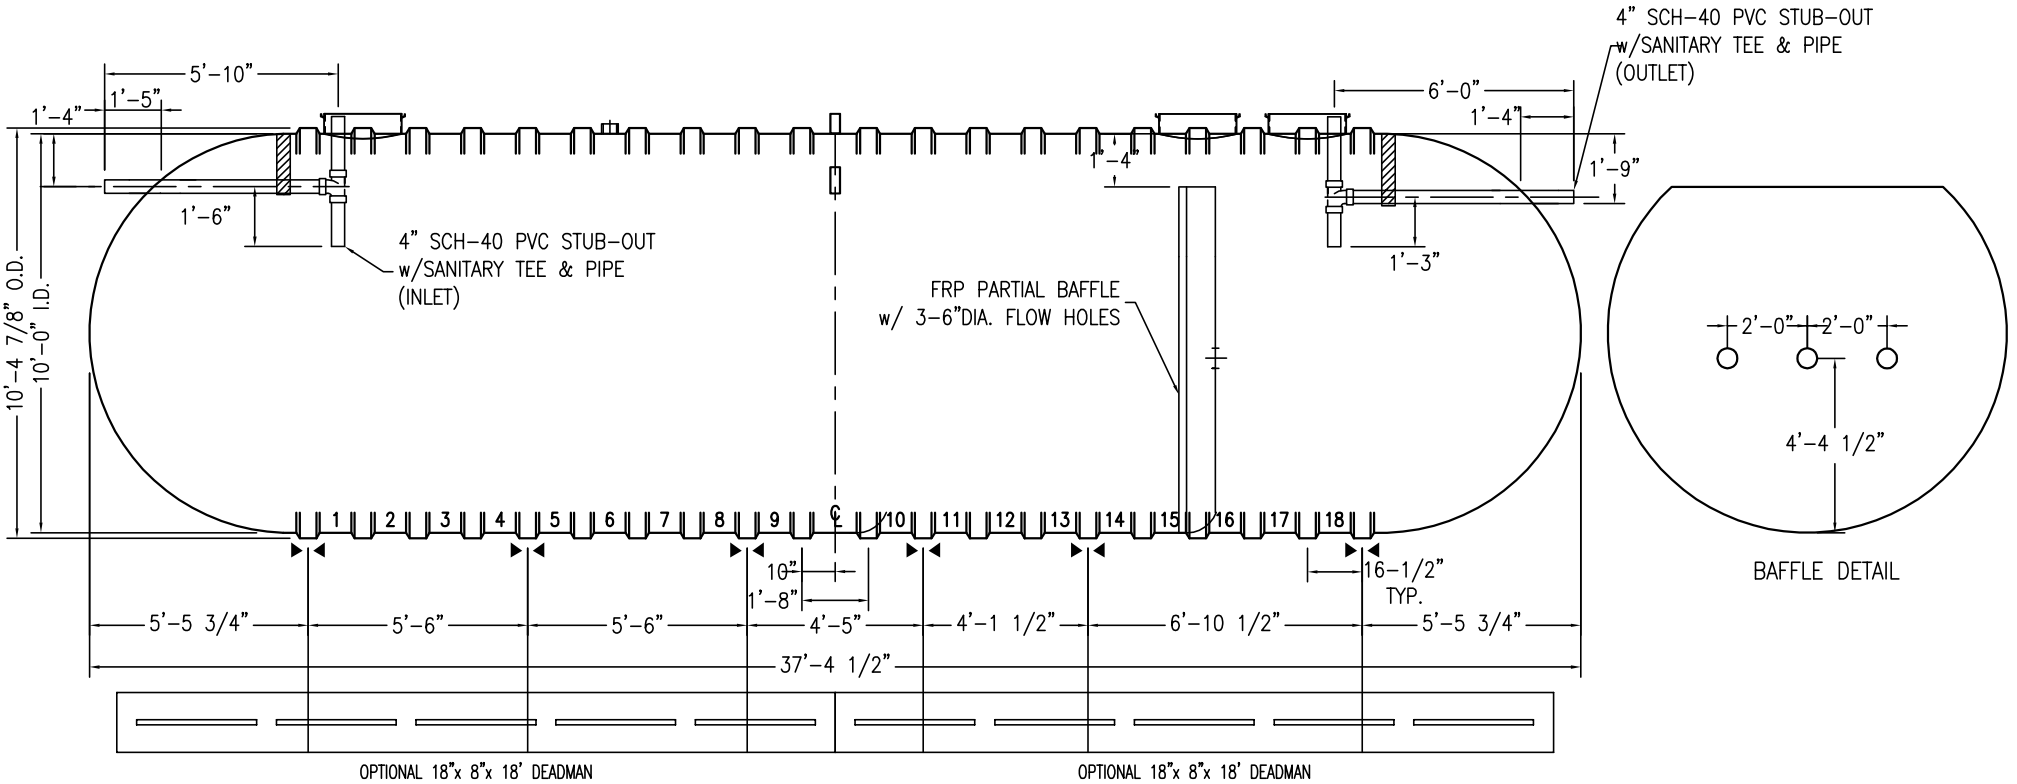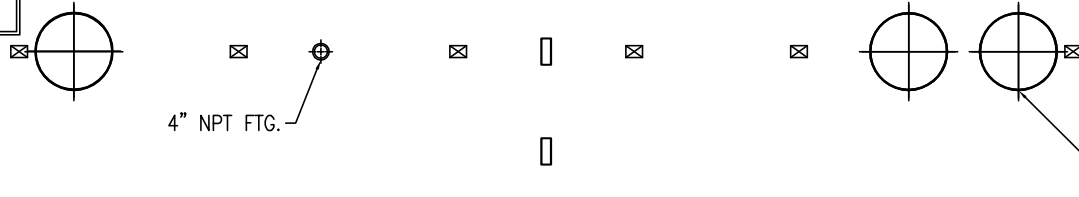

NOTES:

- ☒ HOLD DOWN STRAP CLIP
- ▶◀ HOLD DOWN STRAP LOCATION
- TYPE "13" LIFT LUG - SD
- TYPE "13" LIFT LUG - HD

SWT D-6 (10')-20000		DATE: 1/1/2014
IAPMO SEPTIC TANK		DRAWN BY: K.A.SOEDER
CONTAINMENT SOLUTIONS	CAPACITY: 19,951	REVISED:
	WEIGHT: DRY/WET 6100	DWG NUMBER: 1020MSW-IS