

FLOWTITE PRODUCTS

SEPTIC/WASTE WATER

NOTE: CUSTOMER SUPPLIED
"ASTM C-1644" APPROVED
FLEXIBLE PIPING COUPLING
REQUIRED ON TANGENTIALLY
MTD. NOZZLES, & PIPES


SHELL CODES: 2-EXS10SD, 2-OXS09SD



THIS IS AN IAPMO APPROVED TANK
THE ONLY CHANGE ALLOWED TO
THIS TANK IS TO INCREASE THE
INLET AND OUTLET PIPE DIAMETER.
MFG. PER. PE-C22.85

CAPACITIES:

LIQUID VOLUME BELOW OUTLET = 30,796 GALS
AIR VOLUME ABOVE OUTLET = 4,039 GALS

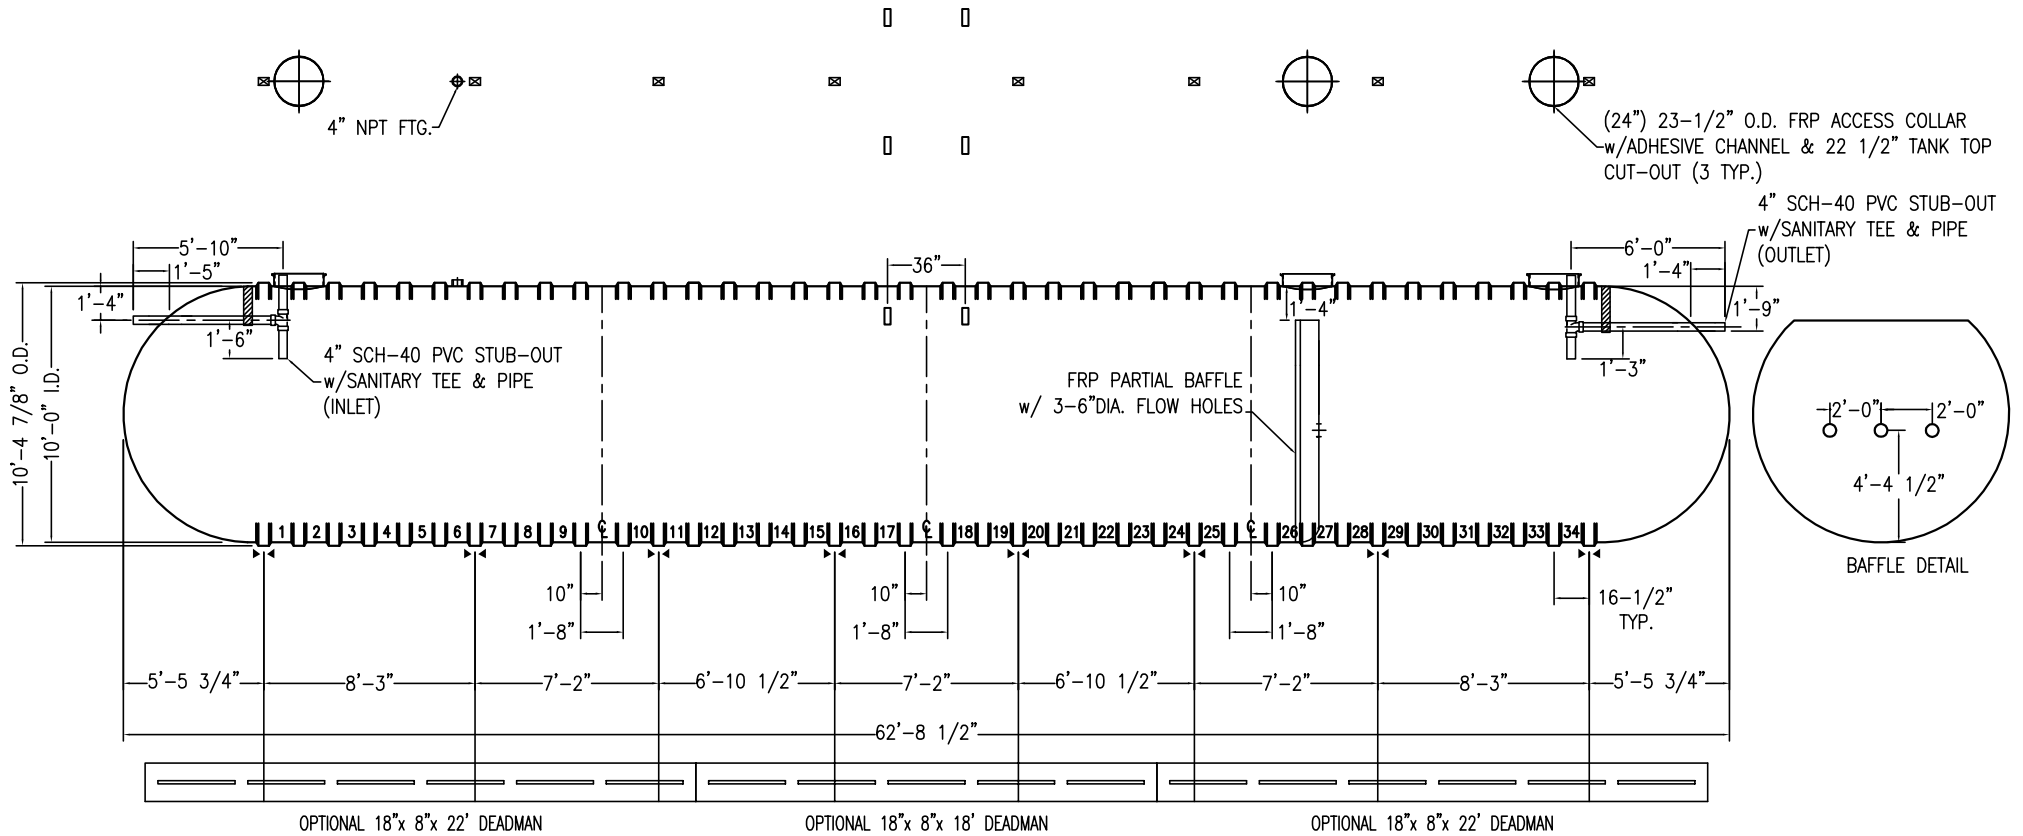

NOTES:

- ☒ HOLD DOWN STRAP CLIP
- ▶◀ HOLD DOWN STRAP LOCATION
- TYPE "13" LIFT LUG - SD
- TYPE "13" LIFT LUG - HD

SWT D-6 (10')-35000		DATE: 1/1/2014
IAPMO SEPTIC TANK		DRAWN BY: J.HARMON
CONTAINMENT SOLUTIONS	CAPACITY: 34,835	REVISED:
	WEIGHT: DRY/WET 10050	DWG NUMBER: 1035SW-IS