


FLOWTITE PRODUCTS

SEPTIC/WASTE WATER


NOTE: CUSTOMER SUPPLIED "ASTM C-1644" APPROVED FLEXIBLE PIPING COUPLING REQUIRED ON TANGENTIALLY MTD. NOZZLES, & PIPES

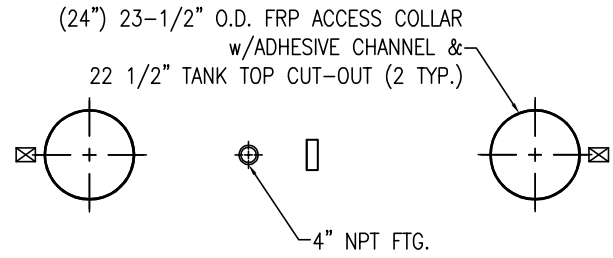

SHELL CODES: 1-E8S10SD, 1-E8SECSD

U P C
THIS IS AN IAPMO APPROVED TANK THE ONLY CHANGE ALLOWED TO THIS TANK IS TO INCREASE THE INLET AND OUTLET PIPE DIAMETER. MFG. PER. PE-C22.85

CAPACITIES:
LIQUID VOLUME BELOW OUTLET = 5359 GALS
AIR VOLUME ABOVE OUTLET = 538 GALS

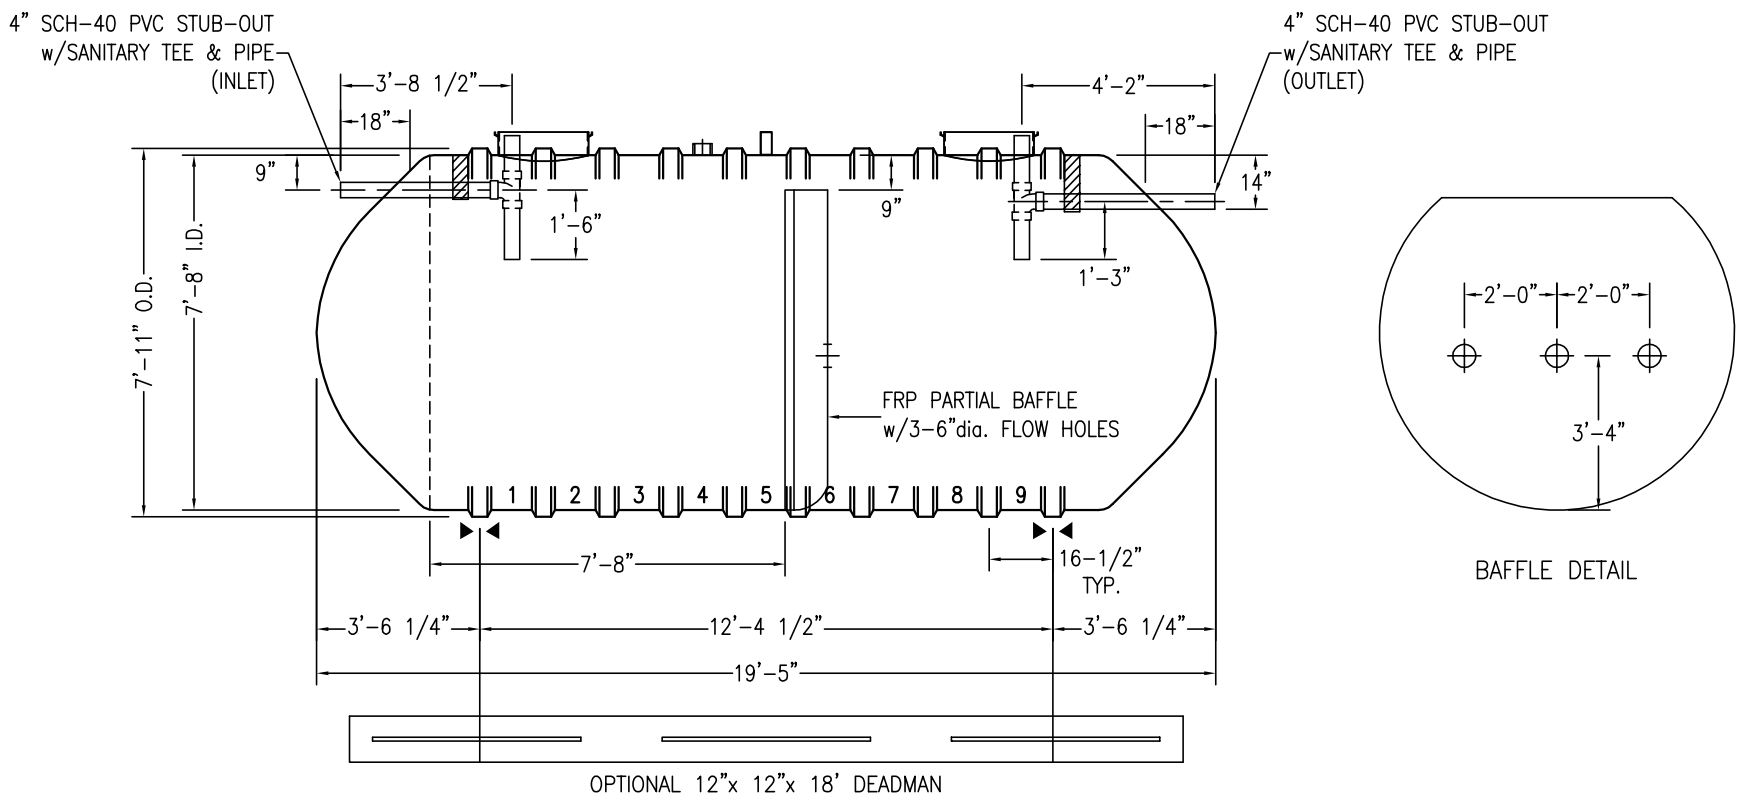

- NOTES:**
- ☒ HOLD DOWN STRAP CLIP
 - ▶◀ HOLD DOWN STRAP LOCATION
 - TYPE "13" LIFT LUG - SD
 - TYPE "13" LIFT LUG - HD

SWT G-6 (8')-6000		DATE:	1/1/2014
IAPMO SEPTIC TANK		DRAWN BY:	K.A.SOEDER
CONTAINMENT SOLUTIONS	CAPACITY:	5,897	
	WEIGHT: DRY/WET	2050	
	DWG NUMBER:	86MSW-IS	