


# TYPICAL 42" VERTICAL PUMP VAULT



## GENERAL NOTES:

1. THE STANDARD PUMP VAULT IS 42" I.D., AND SHALL BE SUPPLIED BY THE TANK MANUFACTURER (36" THROUGH 120" DIAMETER PUMP VAULTS ARE OPTIONAL).
2. FIBERGLASS TOP FLANGE SHALL BE FACTORY INSTALLED TO ACCOMMODATE OPTIONAL VPV COVER OR CONTRACTOR SUPPLIED PUMP MOUNTING PLATE.
3. BOTTOM FIBERGLASS ANTI-FLOTATION RING SHALL BE FACTORY INSTALLED.
4. ALL FRP NOZZLES SHALL BE FLAT-FACED, FLANGED AND CONFORM TO ANSI B16.5 150 POUND BOLTING PATTERNS.
5. FLEXIBLE CONNECTORS MUST BE USED ON ALL PIPING CONNECTIONS, INCLUDES FITTINGS AND FLANGED NOZZLES. PIPING MUST BE FREE TO MOVE INDEPENDENT OF THE TANK AND PUMP VAULT.
6. PUMP VAULTS SHALL BE FRP.
7. PUMP VAULTS SHALL BE INSTALLED ACCORDING TO THE CONTAINMENT SOLUTIONS SUPPLEMENTAL INSTALLATION INSTRUCTIONS IN EFFECT AT TIME OF INSTALLATION.

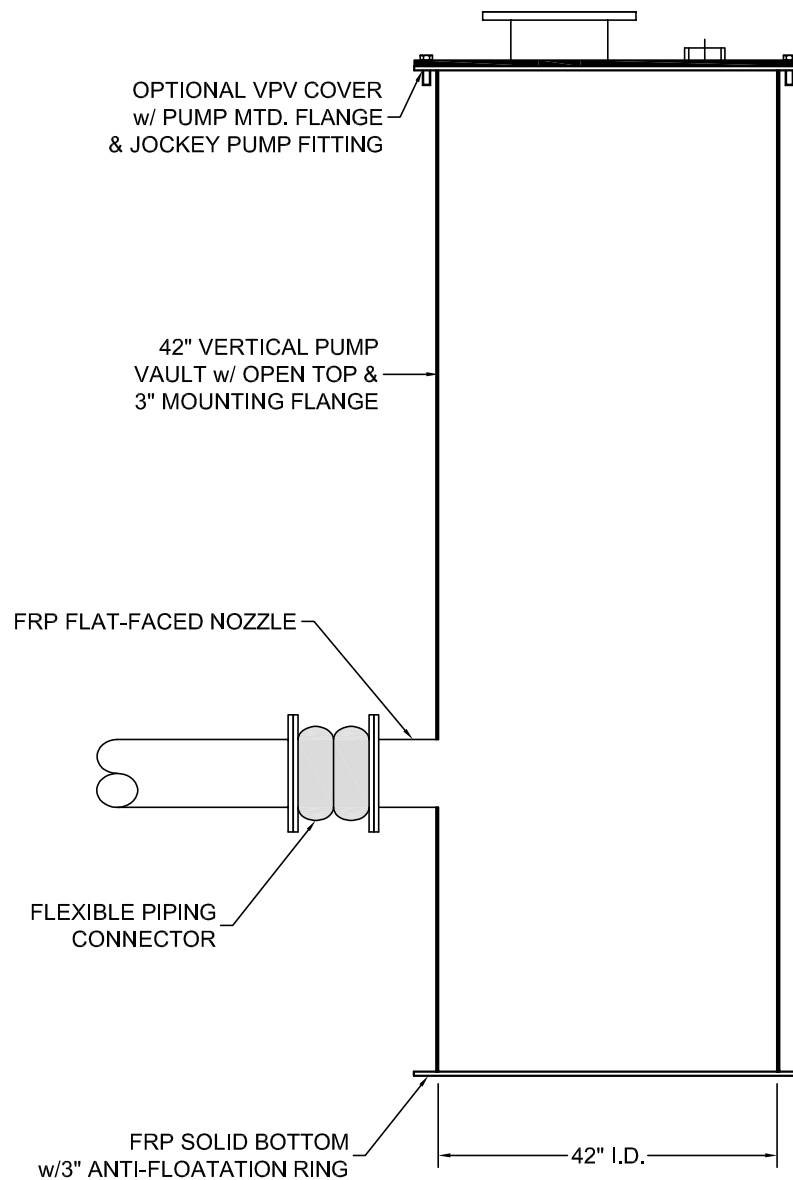

**CONTAINMENT**  
SOLUTIONS®