

**FLOWTITE PRODUCTS**


RAINWATER HARVESTING

NOTE: CUSTOMER SUPPLIED  
"ASTM C-1644" APPROVED  
FLEXIBLE PIPING COUPLING  
REQUIRED ON TANGENTIALLY  
MTD. NOZZLES, & PIPES

SHELL CODES: 2-EST11NU, 1-OST11NU



THIS IS AN IAPMO APPROVED TANK  
COMPLIANCE STANDARDS AND CODES:  
IAPMO/ANSI Z1002  
UNIFORM PLUMBING CODE (UPC)  
MFG. PER PE-C22.85

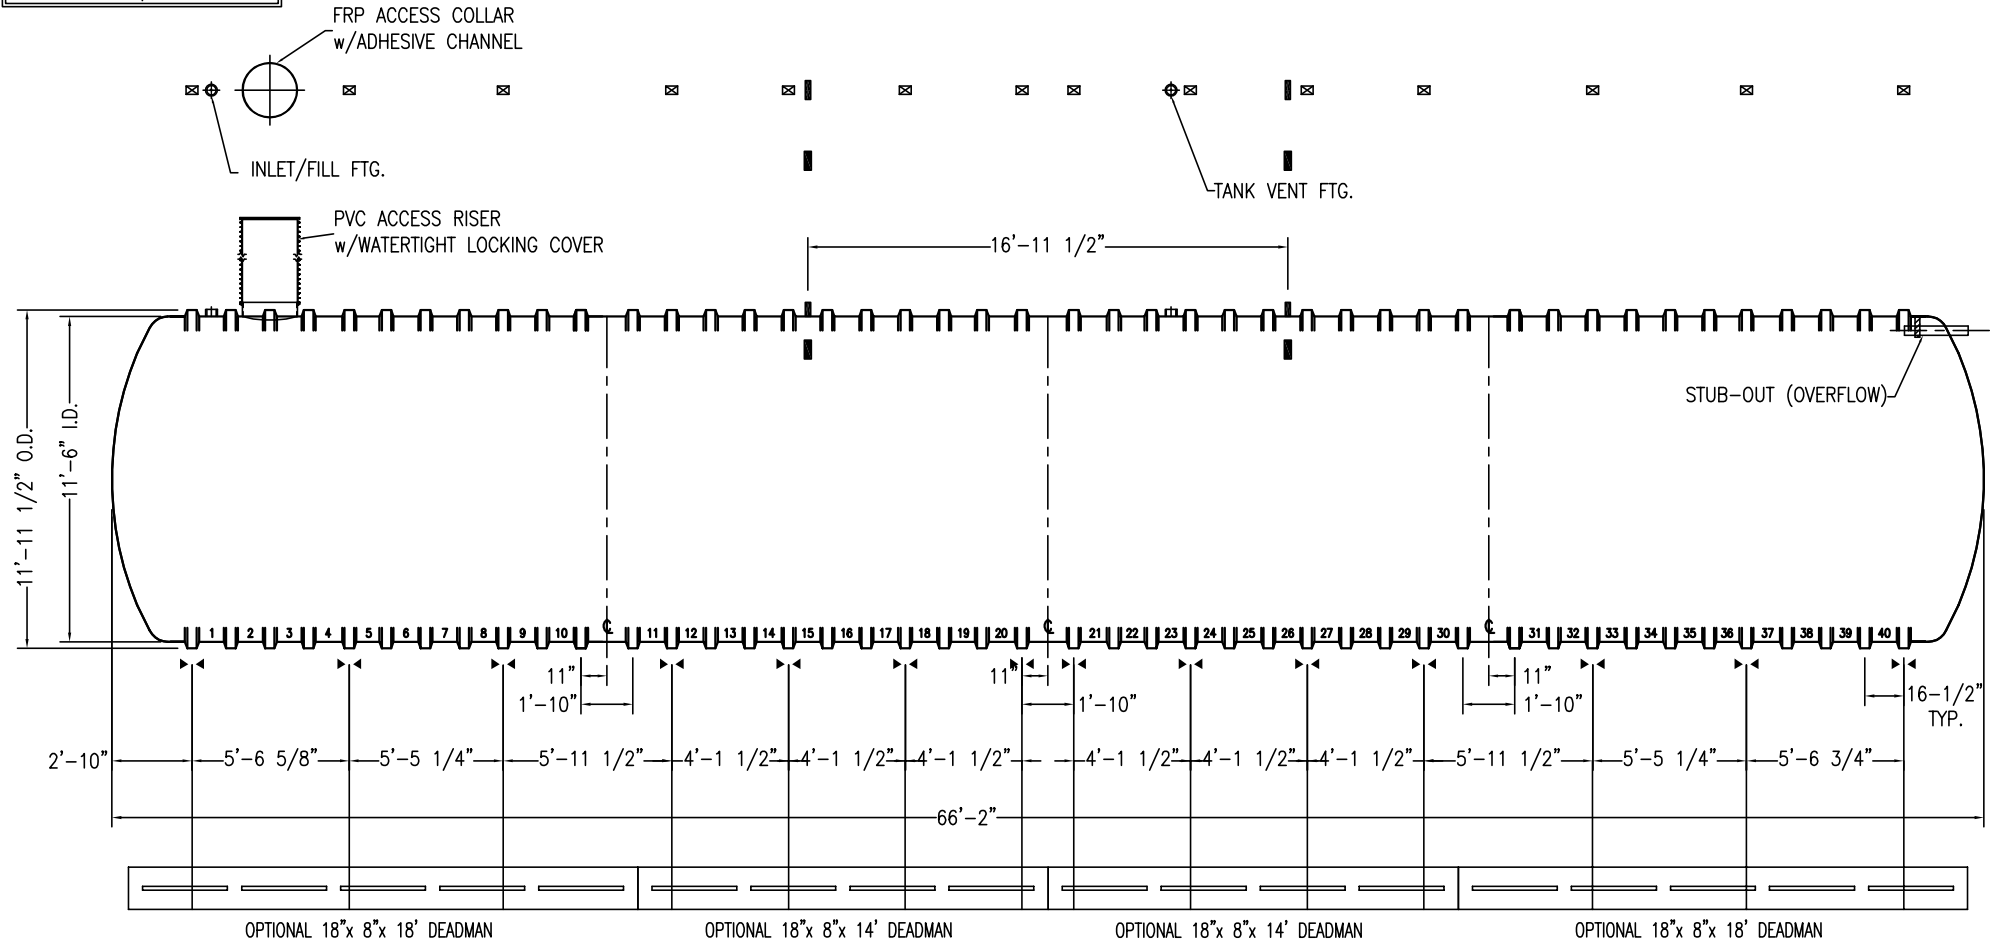

THIS DIAGRAM IS THE PROPERTY OF CONTAINMENT SOLUTIONS, INC., AND IS FOR ILLUSTRATION PURPOSES ONLY. IT IS NOT TO BE RELIED UPON FOR ANY OTHER PURPOSE. NO WARRANTY OF MERCHANTABILITY OF FITNESS FOR A PARTICULAR PURPOSE OR OF ANY OTHER KIND, EXPRESSED OR IMPLIED IS HEREBY MADE. COPYRIGHT © 2016 CONTAINMENT SOLUTIONS, INC. ALL RIGHTS RESERVED.

- IAPMO Z1002 MINIMUM REQUIRED TANK OPENINGS
- 1-ACCESS COLLAR OPENING (24", 30" or 36")
  - 1-ACCESS RISER w/WATERTIGHT LOCKING COVER
  - 1-INLET/FILL FITTING (4" MIN)
  - 1-TANK OVERFLOW (EQUAL TO THE INLET)
  - 1-TANK VENT (EQUAL TO LARGER-INLET OR OVERFLOW)

SWT F1 (12') 50000		DATE: 7/28/2016
IAPMO RAINWATER HARVESTING		DRAWN BY: R.OXNER
<b>CONTAINMENT SOLUTIONS</b>	CAPACITY: 50,090	REVISED: 4/16/17-A
	WEIGHT: DRY/WET 16800	DWG NUMBER: 12-50F1 IRWH