

**FLOWTITE PRODUCTS**

SEPTIC/WASTE WATER

NOTE: CUSTOMER SUPPLIED  
"ASTM C-1644" APPROVED  
FLEXIBLE PIPING COUPLING  
REQUIRED ON TANGENTIALLY  
MTD. NOZZLES, & PIPES

SHELL CODES: 2-E8S0928, 1-O8S1028




THIS IS AN IAPMO APPROVED TANK  
THE ONLY CHANGE ALLOWED TO  
THIS TANK IS TO INCREASE THE  
INLET AND OUTLET PIPE DIAMETER.  
MFG. PER. PE-C22.85

**CAPACITIES:**

LIQUID VOLUME BELOW OUTLET = 13,149 GALS  
AIR VOLUME ABOVE OUTLET = 1396 GALS

23-1/2" O.D. FRP ACCESS COLLAR  
w/23" TANK TOP CUT-OUT  
(3 TYP.)

4" NPT FTG.

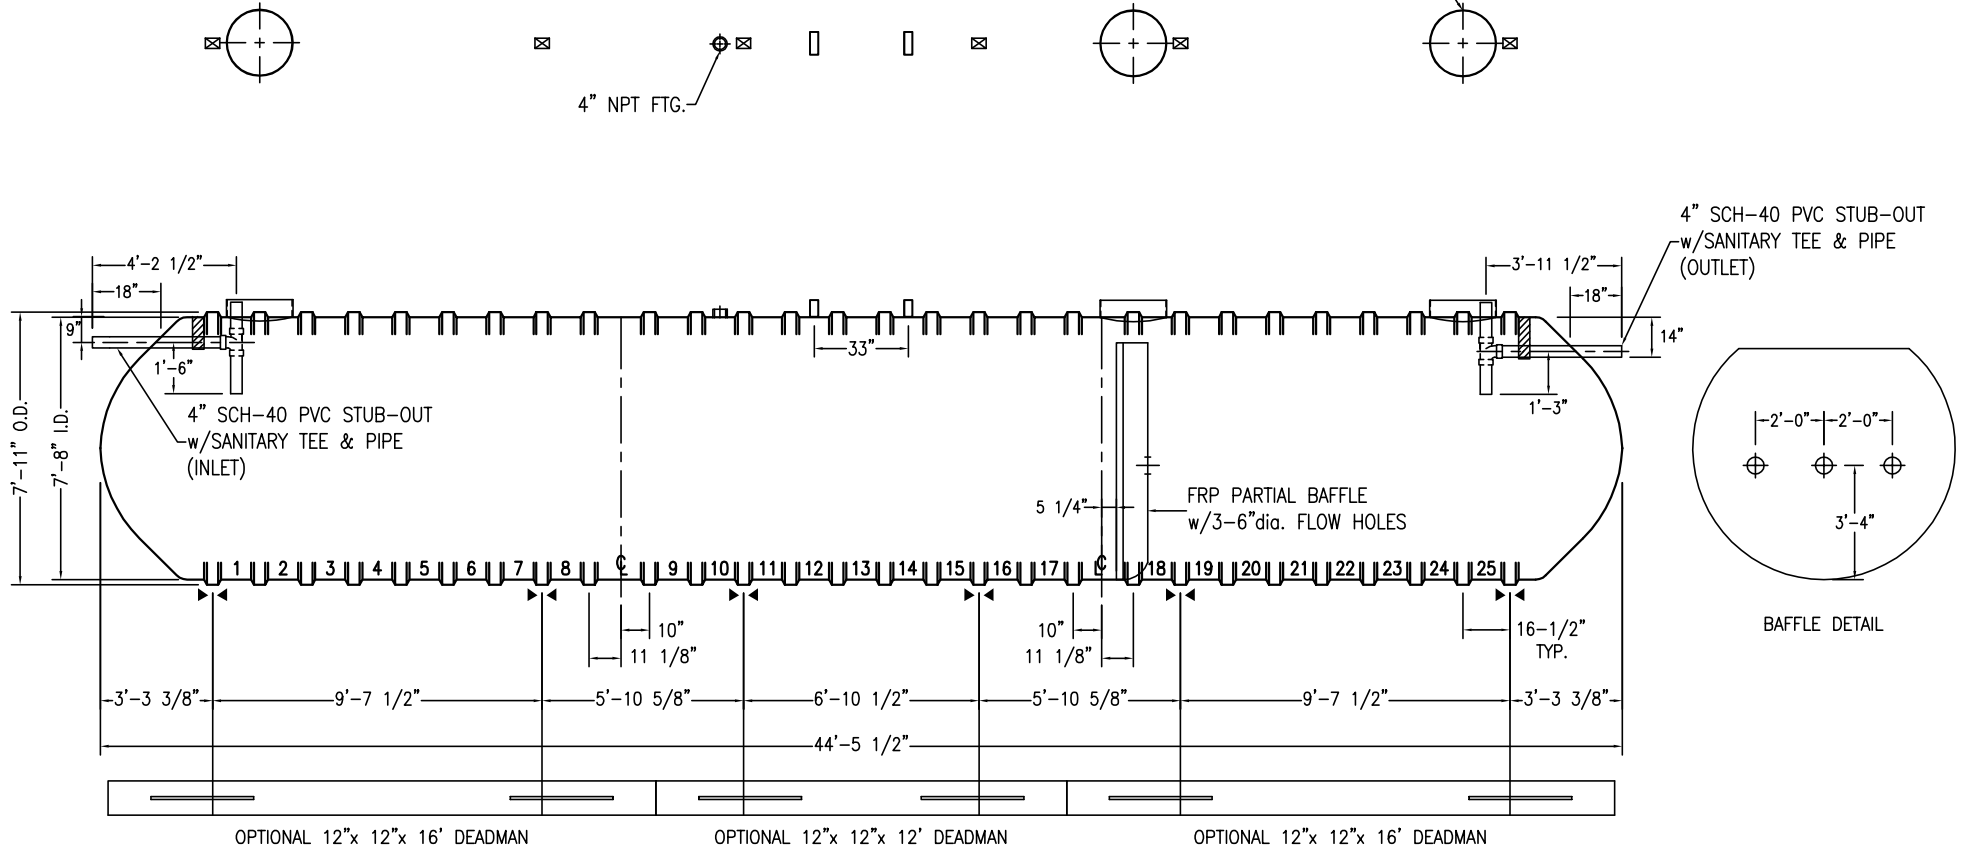

**NOTES:**

- ☒ HOLD DOWN STRAP CLIP
- ▶◀ HOLD DOWN STRAP LOCATION
- TYPE "13" LIFT LUG - SD
- TYPE "13" LIFT LUG - HD

SWT G-6 (8')-15000		DATE: 1/1/2014
		DRAWN BY: J.HARMON
<b>CONTAINMENT SOLUTIONS</b>	CAPACITY: 14,545	REVISED:
	WEIGHT: DRY/WET 4500	DWG NUMBER: 815MSW-IS